


RONIN-PR-BLUE DREAM

Sample ID: SA-250820-67378  
Batch: 25232BDRPA1  
Type: Finished Product - Inhalable  
Matrix: Plant - Flower  
Unit Mass (g):

Received: 08/22/2025  
Completed: 09/03/2025

Client  
CannaBest  
4619 N Santa Fe Ave  
Oklahoma City, OK 73118  
USA

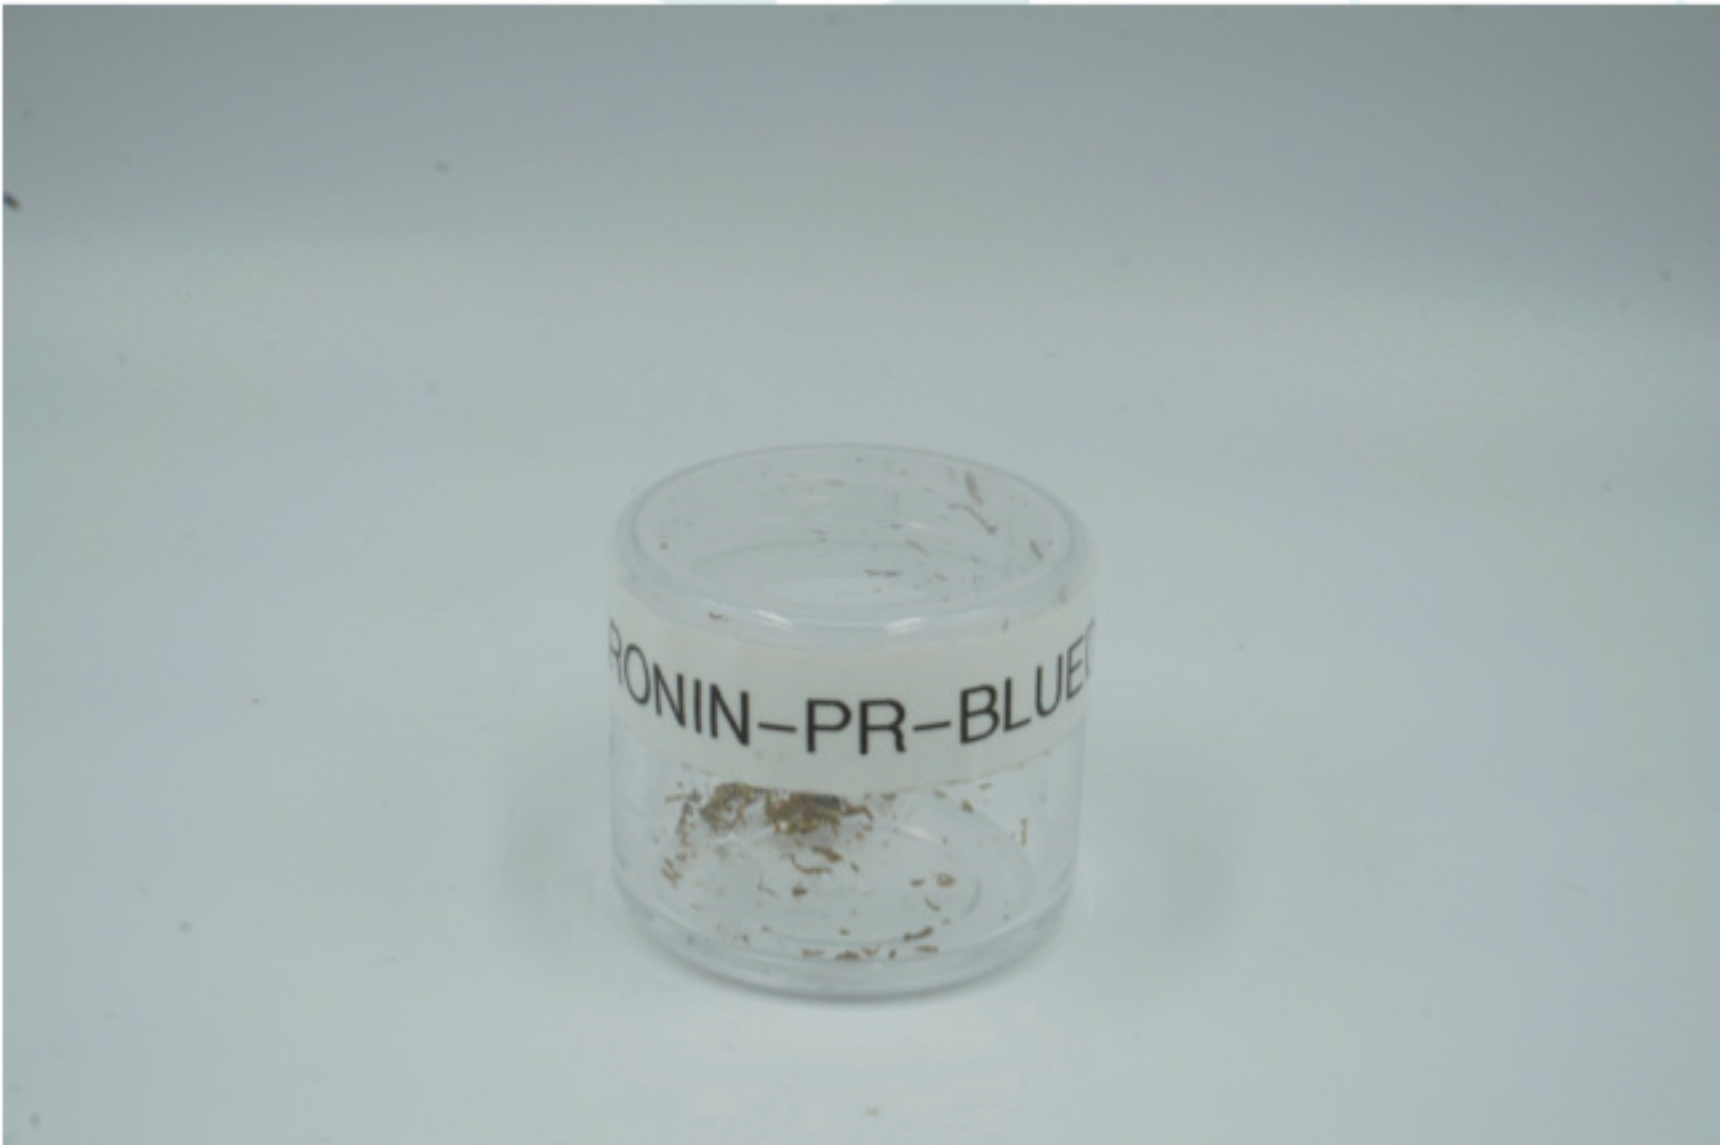

Summary

| Test         | Date Tested | Status |
|--------------|-------------|--------|
| Cannabinoids | 09/03/2025  | Tested |
| Moisture     | 09/03/2025  | Tested |

|          |         |                    |                  |                |                                 |
|----------|---------|--------------------|------------------|----------------|---------------------------------|
| 0.0730 % | 21.5 %  | 31.0 %             | 7.27 %           | Not Tested     | Yes                             |
| Δ9-THC   | Δ9-THCA | Total Cannabinoids | Moisture Content | Foreign Matter | Internal Standard Normalization |

Cannabinoids by HPLC-PDA and GC-MS/MS

| Analyte      | LOD (%) | LOQ (%) | Result (% dry) | Result (mg/g dry) |
|--------------|---------|---------|----------------|-------------------|
| CBC          | 0.00095 | 0.0028  | 0.542          | 5.42              |
| CBCA         | 0.00181 | 0.0054  | ND             | ND                |
| CBCV         | 0.0006  | 0.0018  | ND             | ND                |
| CBD          | 0.00081 | 0.0024  | ND             | ND                |
| CBDA         | 0.00043 | 0.0013  | ND             | ND                |
| CBDV         | 0.00061 | 0.0018  | ND             | ND                |
| CBDVA        | 0.00021 | 0.0006  | ND             | ND                |
| CBG          | 0.00057 | 0.0017  | 2.49           | 24.9              |
| CBGA         | 0.00049 | 0.0015  | 6.14           | 61.4              |
| CBL          | 0.00112 | 0.0033  | ND             | ND                |
| CBLA         | 0.00124 | 0.0037  | ND             | ND                |
| CBN          | 0.00056 | 0.0017  | 0.0265         | 0.265             |
| CBNA         | 0.0006  | 0.0018  | 0.0289         | 0.289             |
| CBT          | 0.0018  | 0.0054  | 0.111          | 1.11              |
| Δ4,8-iso-THC | 0.00067 | 0.002   | ND             | ND                |
| Δ8-iso-THC   | 0.00067 | 0.002   | ND             | ND                |
| Δ8-THC       | 0.00104 | 0.0031  | ND             | ND                |
| Δ8-THCV      | 0.00067 | 0.002   | ND             | ND                |
| Δ9-THC       | 0.00076 | 0.0023  | 0.0730         | 0.730             |
| Δ9-THCA      | 0.00084 | 0.0025  | 21.5           | 215               |
| Δ9-THCV      | 0.00069 | 0.0021  | ND             | ND                |
| Δ9-THCVA     | 0.00062 | 0.0019  | 0.0747         | 0.747             |
| exo-THC      | 0.00067 | 0.002   | ND             | ND                |
| Total Δ9-THC |         |         | 18.9064        | 189               |
| Total        |         |         | 31.0           | 310               |

ND = Not Detected; NT = Not Tested; LOD = Limit of Detection; LOQ = Limit of Quantitation; RL = Reporting Limit; Δ = Delta; Total Δ9-THC = Δ9-THCA \* 0.877 + Δ9-THC; Total CBD = CBDA \* 0.877 + CBD;

[Signature]

Generated By: Ryan Bellone  
Commercial Director  
Date: 09/03/2025

[Signature]

Tested By: Nicholas Howard  
Scientist  
Date: 09/03/2025



ISO/IEC 17025:2017 Accredited  
Accreditation #108651



This product or substance has been tested by KCA Laboratories using validated testing methodologies and an ISO/IEC 17025:2017 accredited quality system. Values reported relate only to the product or substance tested. The reported result is based on a sample weight. Unless otherwise stated, results of tests performed on all quality control samples met criteria for acceptance established by KCA Laboratories. KCA Laboratories makes no claims as to the efficacy, safety or other risks associated with any detected or non-detected amounts of any substances reported herein. This Certificate of Analysis shall not be reproduced except in full, without the written approval of KCA Laboratories. KCA Laboratories can provide measurement uncertainty upon request.